

Final Copy



GOVERNMENT OF NEPAL
MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT
DEPARTMENT OF ROADS
BRIDGE BRANCH

STANDARD SUPERSTRUCTURE DRAWINGS FOR ROAD BRIDGES

25.0m Simply Supported Span, Cast - in - situ,

4 webbed Reinforced Concrete Slab - Deck

SKEW ANGLE : 0° to 15°

(CARRIAGE WIDTH - 7.5m WITH BOTH SIDE FOOTPATH - 1.75m = TOTAL WIDTH - 11.0m)

REFERENCE NOTES:

- All dimensions are in millimeters, unless stated otherwise.
- No dimension shall be scaled from the Drawings; only written dimensions shall be followed.
- Any doubtful Dimensions/Descriptions shall be referred to the attention of the Engineer-in-charge for any corrections (if any) before execution of work.
- Number of reinforcement bars shall not be counted from the Drawings. Only given spacing and/or specified numbers of bars, shall be provided.
- All materials and workmanship shall be in accordance with these NOTES and those in the stated Drawings and shall be generally in accord with the applicable Specifications and relevant Standard/Codes of Practice specified therein and Standard Engineering Practice, if that order.
- This Bridge Superstructure is designed for One Lane of IRC Class 700 Loading, Two Lanes of IRC Class A Loading, and One Lane of IRC Class A Loading, whichever governs, in addition to a Footpath Live Load corresponding to 500 kg/m². 2' of Footpath area per 100 m² of IRC - 6 (2017). However, the present Footpath Load has also been designed for a wheel load of 4 Tons (distributed over a contact area of 300 mm dia.) per 200 m² of IRC - 6 (2017), allowing 25% increase in stresses due to flexure.
- The Contractor shall be responsible for constructing and maintaining all parts of the structure in stable, acceptable and serviceable condition, ensuring no part under construction is unduly stressed and unsafe.

8. CONSTRUCTION SEQUENCE: Entire Deck (a) the Superstructure comprising the cast in situ Reinforced Concrete four webbed slab shall preferably be constructed in one operation in one day for the span. If this is not possible, then the four slabs shall be cast one after the other up to about 150 mm below the top reinforcement (i.e. 150 mm) (if possible) otherwise on two successive days, after the other, along with the Cross Girders, and then the slab on the next day. This entire Deck must be cast in situ on staying in place in no more than three successive days.

9. CEMENT:
A. High strength Ordinary Portland Cement 53 Grade, conforming to IS: 12269 or 43 Grade conforming to IS: 8112, capable of achieving the required design concrete strength and durability shall be used.
B. Cement shall be obtained from approved Manufacturers only.
C. Cement content in the Concrete Mix for Reinforced Concrete shall not be less than 350 kg/m³ and not more than 450 kg/m³.

10. COARSE AND FINE AGGREGATE:
A. Maximum size of Coarse Aggregate used shall be 20mm. Fineness Modulus of Sand (Fine Aggregate) shall not be less than 2.3. Both these Aggregates shall be of Approved Quality from Approved Sources, and of Approved Gradations, etc. conforming to IS: 381 (1970), in zones of congestion in the structural sections, if absolutely necessary, 12 mm down sized Coarse Aggregates may be used (but the Mix shall then be re-designed to suit).
B. In zones of congestion in the structural sections, if absolutely necessary, 12 mm down sized Coarse Aggregate may be used (but the Mix shall then be re-designed to suit).


11. ADDITIVES: To suitably improve workability and increase initial setting time of concrete and cement grout, Admixtures conforming to IS: 9103, and ASTM C-484 Type F Water-reducing, high range admixtures, shall be permitted in appropriate dosages, subject to their satisfactory proof use.

12. REINFORCEMENT:
A. All reinforcing steel bars shall have High Yield Strength Deformed type and Thermally Mechanically Treated having specified minimum 0.2 per cent proof stress of 500 MPa conforming to IS: 1786.
B. Minimum lap length of reinforcement bars shall be 55d where d is the dia. of the smaller bar or be lapped (unless otherwise specified).
C. Not more than 50 percent of reinforcement crossing a section shall be lapped at that location.
D. All laps in reinforcement shall be properly staggered and minimum distance between the laps shall be 1.33 times the lap length.
E. Bending of reinforcement bars shall be as per IS: 1922.

13. WATER: Water for concrete and for its curing shall be of potable quality and presence of any salts, sulfates and pollutants like chlorides, sulphates, alkalis, etc., shall be well within their limits specified in the relevant Specifications.

14. CONCRETE AND CURING:
A. **WATER-CEMENT RATIO** by weight, shall not exceed 0.45 for Reinforced concrete.
B. **MINIMUM CLEAN CONCRETE COVER** to reinforcement bars shall be 40mm.
C. **CONTROL OF SURFACE EVAPORATION**

SURFACE EVAPORATION FROM PLASTIC CONCRETE

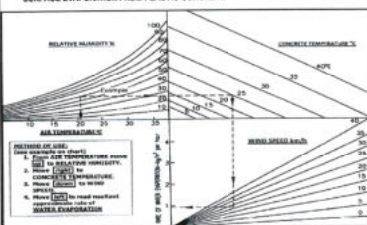

Use the graphical Figure below to estimate and control the loss of water through surface evaporation in the laid concrete over 10 mm or more of the following actions shall be taken to reduce the surface evaporation rate to no more than one kilogram of water per square meter of surface area per hour.

- Control Windbreakers to effectively reduce the wind velocity (to suit) in the area of concrete placement. The construction of windbreakers or enclosures should not proceed without approval of the Engineer with respect to their structural design relative to safety, stability, adverse loads, and vibrations in the false work.
- Install stationary Fog Sprayers upwind of the concreting operation to effectively increase the relative humidity in the area of concrete placement.
- When necessary, effectively reduce the temperature of concrete (to suit) by cooling one or more of its components as well as lightly spray wet the slabs and the tied reinforcement, i.e., if added to the mix-water, shall be completely moist prior to using that water.

D. GRADIES OF CONCRETE
The structural components involved in this Bridge Deck shall be suitably designed as High Strength Concrete Mixes having 28 days minimum water Cube Crushing Strength in Compression on 150 mm Standard Cubes as follows:

For the cast in situ (a) Reinforced Concrete A-Modified Deck Superstructure (i.e. for Slabs, Stems, Girders, Side and Cross-ribs)	35 MPa (i.e. M-35 Grade Concrete)
For the Reinforced Concrete in: - Precast Footpath Slabs - Piercap Slabs and their Bases - Road Kerbs	

E. CONSTRUCTION JOINTS:
A. As far as possible the location of Construction Joints shall be as shown in the Drawings, but if not shown on the Drawings but found absolutely necessary, they shall be planned in advance and the placing of concrete carried out continuously from joint to joint.

B. A Construction Joint should not be located near the centroid level of the section as transverse SHEAR stress is highest. The joint should be nearly perpendicular to the principal lines of tensile stress and in general be located at points of minimum shear and minimum moment, as far as possible.

C. Where dowels, reinforcing bars, or other adequate links are not shown at Construction Joints in the Drawings, they shall be formed at least absolutely necessary by embedding water-cured twisted linkers while the concrete is still soft.

D. These keys should be sized as may be shown in the details, or as directed by the Engineer, and these key-forming timbers shall be removed when the concrete has attained set.

E. In resuming concreting work, the surface of the concrete previously placed shall first be thoroughly cleaned of dirt, slum, laitance, loose particles, aggregates and any other soft material, using stiff wire brushes, and, if desired, necessary, by the Engineer, to sand blasting.

F. The concrete surface shall then be thoroughly soaked with clean water (just before further concreting) and the wet water, etc. in-between areas, and the cleaned concrete surface painted with a thin layer of cement slurry, and only then further concrete poured.

vii. "Wire-mesh" and other similar items do not provide a proper construction joint, and they shall not be used.

F. COSE JOINTS:

i. When a planned longitudinal construction joint in any structural member is interrupted or delayed, for any reason, for a period long enough for the equipment partially placed concrete to take its initial set, the Engineer may decide such a joint as a Cold Joint and the Contractor shall immediately remove the previously partially placed concrete from the Forms.

ii. However, where feasible, the previously partially placed concrete may instead be suitably and carefully hatched and hatched and brought into low shear low normal zone as far as possible, and given shear key depressions after bringing it nearly perpendicular to the principal lines of tensile stress, for example, brought to vertical or nearly vertical in a beam with principal bending reinforcement, horizontal, and thereafter some treatment shall be given to it as a Construction Joint and only then the concreting resumed (making sure all reinforcements are as per the approved Drawings and the Shuttering has been brought to line and plumb tightly).

G. CURING AND PROTECTION OF YOUNG CONCRETE:

i. All structural concrete shall be cured for a period of time required to obtain the specified strength, but for not less than fourteen consecutive days (and nights) beginning immediately after initial setting of concrete (which is when it loses its surface sheen).

ii. Curing Membrane-curing or Water-curing of laid concrete shall be carried out as generally explained below:

A. Membrane-Curing the Concrete:

- Except for all Construction Joints and surfaces sealed by Forms, liquid membrane curing compound can be used (for curing the concrete) as follows:
- On bridge deck top surface and other exposed surfaces, liquid membrane curing compound shall be applied soon after initial setting and as the Surface Sheen has disappeared and the concrete is still slightly damp (not wet).
- On shuttered or formed vertical surfaces, Forms shall be stripped as soon as practical (generally after 24 hours of casting) and liquid membrane curing compound applied immediately except in the areas that require railing or finishing during the curing period.
- These areas shall be kept water-tight until their finishing is completed, where after the liquid curing membrane shall be uniformly applied on them also when their surface is about curing.
- White emulsion liquid membrane curing compound shall be used for all surfaces where the structure temperature during curing period is likely to reach about 35°C or more.

For bridge decks which are to receive an asphaltic overlay, residual curing membranes (after curing) shall be removed prior to the overlaying.

Removal methods and results should be approved by the Engineer.

The membrane curing compound used shall be of longer lasting duration and in accordance with the requirements specified for curing membrane material, AASHTO M 148 or the equivalent ISI Specification.

The curing membrane shall be applied in two applications one immediately following the other.

The rate of each application of curing compound shall be as prescribed by the manufacturer with a spreading rate per application of at least one liter of liquid per five square meters of concrete surface.

If the concrete has dried off or has become dry, it shall be thoroughly wetted with water and the curing compound applied just as the surface film of water disappears and the surface is damp.

During curing operations any unexposed surfaces shall be kept cured with wetted Hessian cloth, and sprayed with the curing compound when Surface is damp (not wet).

Any curing membrane material on Construction Joints and/or on reinforcing steel shall be completely removed before the following concrete pour.

Hand operating spraying equipment shall be capable of applying constant and uniform pressure to provide uniform and even distribution of the curing membrane at the sites required.

The curing compound shall be kept thoroughly mixed at all times during stage 1 application.

No traffic of any kind shall be permitted on the curing membrane until the curing period is completed, design permitting.

iv. Water-Curing the Concrete:

A. All concrete surfaces, unless still sealed by unremoved Forms (which shall be kept from heating up under ambient temperature) or submerged, shall be water-cured using liquid membrane curing.

B. Water curing shall begin just after initial setting of concrete (which generally occurs by about 60 minutes of placement of un-shrinkage concrete) and after about 120 to 180 minutes of placement of shrinkage concrete) and just after the surface water sheen has disappeared.

C. Surfaces water-cured shall be covered with wet sand, cotton mats, or double-thickness burlap (Jute-Hessian) sheets.

D. This Hessian material shall be placed tightly around and behind any projecting reinforcing steel in order to completely cover the fresh concrete surface.

iv.e. The Hessian material shall be completely saturated with water and kept continuously saturated throughout the curing period.

iv.f. After the initial saturation, unless water is kept running, all surfaces shall be covered with thick polythene sheeting or other approved impervious material in order to protect/prevent drying-up of concrete surface being cure continuously.

iv.g. The sheeting shall be weighed down or secured well to prevent moisture loss but the surfaces of the concrete shall be readily available for inspection of the Engineer (or his Representative).

iv.h. The sheeting material shall be in good repair.

iv.i. Sheetings that contains holes or is otherwise damaged shall be repaired or replaced immediately.

iv.j. The Contractor shall be responsible for thoroughly inspecting and monitoring the concrete surfaces throughout the curing period to ensure continuous wet surface.

iv.k. Additional water shall be poured in any areas where saturation is reduced.

iv.l. Inspection of curing by the Contractor shall be conducted at least 12H times per day and night for the duration of the curing period - and even more often if ordered so by the Engineer.

iv.m. The Engineer shall be advised of the curing inspection schedule and he (or his Representative) may accompany the workers to verify the acceptability of curing.

v. "COLD-WEATHER" CURING:

A. When concrete is placed and the air temperature is expected to drop below 5°C during the curing period, the Contractor shall provide suitable measures such as straw, additional burlap or other suitable insulating material around and housing and artificial hot-air-curing to maintain the concrete temperature between 10°C and 32°C as measured on the surface of the concrete.

B. The surface of the concrete shall be kept moist and warm by the use of an approved warm moisture barrier such as warm wet burlap/Hessian.

C. The moisture barrier shall be maintained in intimate surface contact with the concrete surface during the curing period.

D. After the completion of the curing during the entire required curing period, the Contractor shall stop the curing and remove the protection in such a manner that rapid cooling of the concrete will be prevented.

E. When concrete is placed in "cofferdams" and subsequently flooded with ground water, the above curing precautions may be waived, provided the surface of the water is not permitted to freeze.

vi. "CONCRETING" IN ADVERSE WEATHER CONDITIONS:

1. "Concretng" in "Cold" Weather:

A. Concrete that freeze soon after placing, gains lower low strength and some permanent damage is certain to occur. Therefore, such concrete shall be removed and replaced immediately.

B. Planning for Protection of fresh concrete during placement, until it has attained the minimum properties required for the environment and the loading to which it will be exposed, shall be done well in advance of concreting and approved by the Engineer.

C. Appropriate equipment shall be made available in time for heating the concrete materials, for constructing enclosures and for maintaining favourable temperatures even after the concrete is placed.

D. Concrete shall never be placed in cold Forms and cold steel.

E. When the temperature of these items is below 5°C, the Contractor shall use means to raise their temperatures to above 10°C.

F. When faced with prolonged cold temperatures, all aggregates, or mixing water, or both, shall be heated to about 25°C to 32°C.


G. At temperatures at least 10°C above freezing, it is seldom necessary to heat the Aggregates.

H. At temperatures below or at freezing, other than the Fine Aggregate is heated to produce concrete of the required temperature, provided the Coarse Aggregate is free of frozen lumps and the Temperature of Water for the Mix is at least 10°C.

I. If aggregate temperatures are above freezing, the desired concrete temperature usually can be obtained by heating only the mixing water.

CONTINUE ...


GOVERNMENT OF NEPAL MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT DEPARTMENT OF ROADS BRIDGE BRANCH		
STANDARD SUPERSTRUCTURE DRAWING FOR ROAD BRIDGES		
Bridge Component: Middle T-Box Span: 2 Footpaths each 1.5m wide	Overall Deck Width: 11.00 m	
Effect: Simply Supported (Reference to Drawing: 250 m and Reinforcement)	LIVE LOAD: IRC Class I Lane of 100 kN or 2 Lanes of Class A, whichever governs and Reinforcement	
Dwg. No.: 17 of A-Modified RC-Slab Deck on SS-Span		
Dwg. Title: REFERENCE NOTES (1 Sheet) Sheet 02		
Reviewed by: Amit Kumar Verma (Engineer, Civil)	Prepared by: Jyoti Mishra (SOL, Civil)	Date: 10/11/2023
Reviewed/checked by: Dipak Shrestha (DDG, Civil)	Approved by: Amit Kumar Verma (SOL, Civil)	Signature: [Signature]

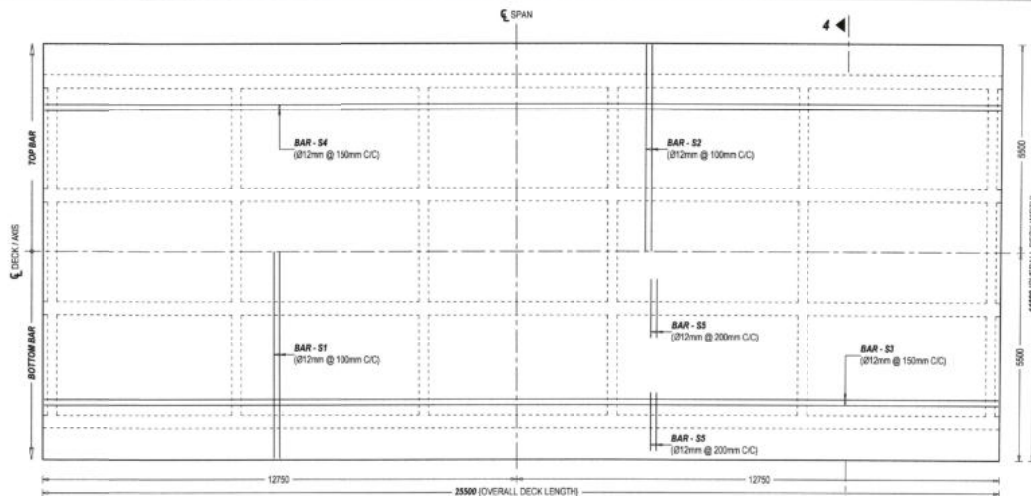

REINFORCEMENT DETAILS OF DECK - PLAN VIEW


SCALE - 1 : 100 @ A3 PAPER

19900 (OVERALL DECK WIDTH)

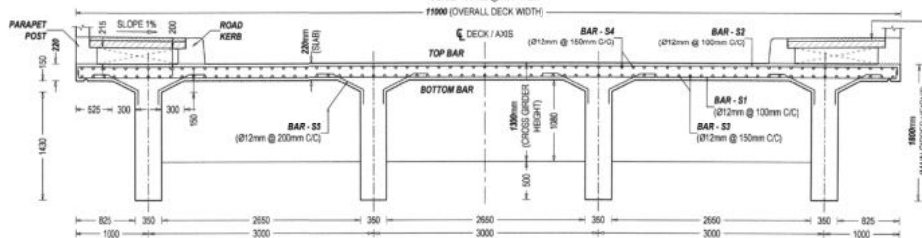


REINFORCEMENT DETAILS OF DECK - SECTIONAL VIEW (SEC 4 - 4)

SCALE - 1 : 50 @ A3 PAPER



REINFORCEMENT DETAILS OF PARAPET POST - SECTIONAL VIEW

SCALE - 1 : 25 @ A3 PAPER




REINFORCEMENT DETAILS OF ROAD KERB - SECTIONAL VIEW

SCALE - 1 : 25 @ A3 PAPER




SECTIONAL VIEW OF POST (SECS-5)

SCALE - 1 : 60 @ A3 PAPER

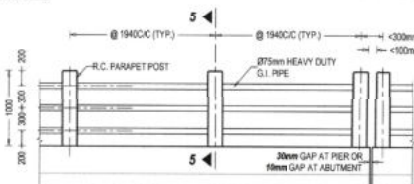


ELEVATION VIEW OF PARAPET POST

SCALE - 1 : 50 @ A3 PAPER

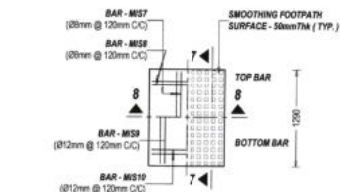


HALF SECTIONAL PLAN VIEW OF PRECAST R.C. FOOTPATH SLAB

SCALE - 1 : 50 @ A3 PAPER



SECTIONAL DETAIL (SEC 7 - 7)

SCALE - 1 : 50 @ A3 PAPER



SECTIONAL DETAIL (SEC 8 - 8)

SCALE - 1 : 50 @ A3 PAPER

Concrete Terra Stone Pavestones
400x400x30mm (URBAN AREA) OR
M15 50 mm THK Concrete Flooring
(SMOOTHING FOOTPATH SURFACE)




SECTIONAL REINFORCEMENT DETAILS OF PARAPET POST (SEC 6 - 6)

SCALE - 1 : 20 @ A3 PAPER






NOTES:

- Concrete flooring tiles on footpaths in urban area and luminous approach road. In other regions 50 mm thick M20 Concrete flooring above concrete precast slab can be provided for smooth surface in footpaths.
- Maximum width of footpath slab is 1.0m and footpath slab shall be of appropriate size.





GOVERNMENT OF NCT OF DELHI MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT DEPARTMENT OF ROADS BRIDGE BRANCH		
STANDARD SUPERSTRUCTURE DRAWING FOR ROAD BRIDGES		
Road Overpassing Width: 7.50m with 2 Footpaths each 1.50m wide	Overall Deck Width: 11.00 m	
Effective Simply Supported Span (center to center of Bearings) 25.1 m Reinforced Concrete Deck (see SEC 6)	LANE LOAD: IRC 1 Lane of T90 or 1 or 2 Lanes of Class A, whichever governs, and Footpath Loading	
Org. No.: 417 of 4-Webbed RC-Slab-Deck 25.1 m-S5 Span		
REINFORCEMENT DETAILS OF DECK SLAB, FOOTPATH SLAB, ROAD KERB & PARAPET POST		
Reviewed by: Anil Kumar Varma (Engineer, O&R)	Forwarded by: Jyoti Kishore (SCE, O&R)	Date: June 2021
Recommendation by: Dipak Chandra (DDG, O&R)	Approved by: Sudip Kumar (SCE, O&R)	Remarks: अनुमति दी गई है

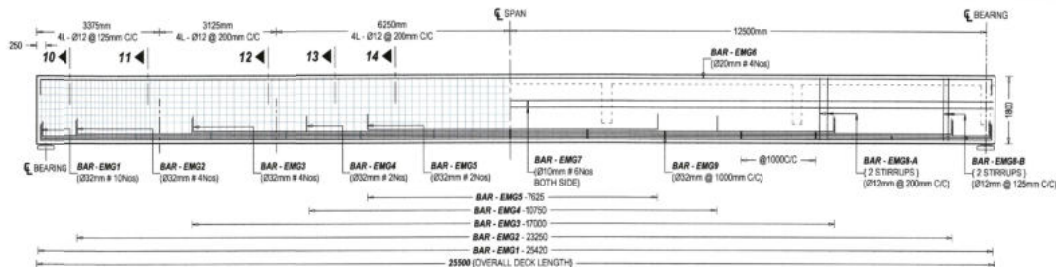

REINFORCEMENT DETAILS OF EXTERNAL MAIN GIRDER - LONGITUDINAL HALF SECTIONAL VIEW
SCALE - 1:100 @ A3 PAPER

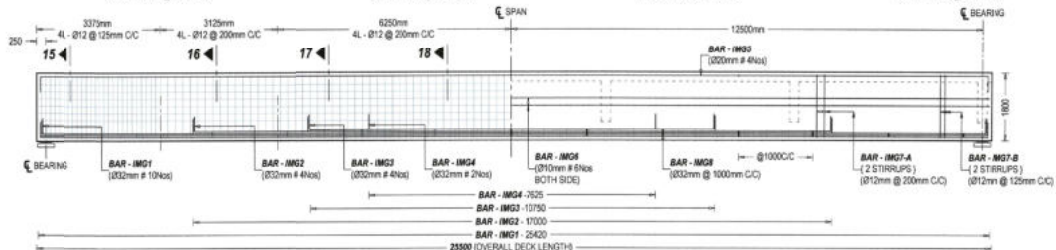

REINFORCEMENT DETAILS OF INTERIOR MAIN GIRDER - LONGITUDINAL HALF SECTIONAL VIEW
SCALE - 1:100 @ A3 PAPER




EXTERNAL MAIN GIRDER BAR ARRANGEMENT DETAIL (DETAIL AT C)
SCALE - 1:10 @ A3 PAPER



INTERIOR MAIN GIRDER BAR ARRANGEMENT DETAIL (DETAIL AT D)
SCALE - 1:10 @ A3 PAPER

GOVERNMENT OF NEPAL MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT DEPARTMENT OF ROADS BRIDGE DIVISION		
STANDARD SUPERSTRUCTURE DRAWING FOR ROAD BRIDGES		
Based on: Standard Specifications for Road and Bridge Construction, 1995 with 2010 Supplement and 2011 Addendum	Overall Deck Width: 11.80 m	
Effective Simply Supported Span (center to center of bearings): 25.0 m	LIVE LOAD: IRC 1 Lane of 10R or 1 or 2 Lanes of Class A, whichever governs.	
Reinforced Concrete Deck	and Full-depth Leaning	
Dwg. No.: 97 of 4-Wheeled RC-Slab Deck 25.0 m-Span		
REINFORCEMENT DETAILS OF LONGITUDINAL GIRDER		
Reviewed by: Anil Kumar Vajrappa (Engineer, DOB)	Forwarded by: Jyoti K. Sharma (SCE, DOB)	Date: June 2021
Recommended by: Gopal Chandra (DOB, DOB)	Approved by: Gopal Chandra (DOB, DOB)	Signature: Gopal Chandra



GOVERNMENT OF NEPAL MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT DEPARTMENT OF ROADS BRIDGE BRANCH		
STANDARD SUPERSTRUCTURE DRAWING FOR ROAD BRIDGES		
Road Carriageway Width: 13.80 m with 2 Footpaths each 3.00 m wide	Overall Deck Width: 19.80 m	
Effective Support Span Length: Order to order of Piercap: 25.0 m Reinforced Concrete Deck (in SEW)	LIVE LOAD: RCI 1 Lane of 70R or 1 or 2 Lanes of 1.4, 4.0 m wheelbase, and Footpath Loading	
Dep. No.: 67 of 4-Webbed RC-Slab Deck 25.0 m-Span		
REINFORCEMENT DETAILS OF CROSS GIRDER & MISCELLANEOUS DETAILS		
Reviewed by: Arjun Kumar Virmiya (Engineer, Civil)	Formulated by: Jeetendra Mishra (S.D.C. Clerk)	Date: June 2021
Recommendation by: Chandra Sheelwa (D.O. Clerk)	Approved by: Arjun Kumar Thapa (D.O. Clerk)	Reviewed by: Arjun Kumar Thapa (D.O. Clerk)

BAR BENDING SCHEDULE OF EXTERIOR MAIN GIRDER (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	EMG 1		32	26220	10	262.20	1659.27
2	EMG 2		32	24050	4	96.20	607.31
3	EMG 3		32	17800	4	71.20	448.49
4	EMG 4		32	11550	2	23.10	146.83
5	EMG 5		32	8425	2	16.85	106.37
6	EMG 6		20	26220	4	104.88	256.53
7	EMG 7		10	25420	12	305.04	186.21
8	EMG 8		12	7880	149	1174.12	1042.62
9	EMG 9		32	245	98	24.01	151.58
Total Weight (KG)							4603.31

BAR BENDING SCHEDULE OF INTERIOR MAIN GIRDER (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	IMG 1		32	26220	10	262.20	1659.27
2	IMG 2		32	17900	4	71.20	448.49
3	IMG 3		32	11550	4	46.20	291.66
4	IMG 4		32	8425	2	16.85	106.37
5	IMG 5		20	26220	4	104.88	256.53
6	IMG 6		10	25420	12	305.04	186.21
7	IMG 7		12	7880	149	1174.12	1042.62
8	IMG 8		32	245	98	24.01	151.58
Total Weight (KG)							4143.83

BAR BENDING SCHEDULE OF DECK SLAB (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	S1		12	11120	256	2846.72	257.89
2	S2		12	11120	296	2846.72	257.89
3	S3		12	25620	74	1895.68	1683.54
4	S4		12	25620	74	1895.68	1683.54
5	S5		12	1700	516	877.20	78.95
Total Weight (KG)							9291.81

BAR BENDING SCHEDULE OF MID CROSS GIRDER (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	MC1		20	9570	6	57.42	141.60
2	MC2		20	9570	4	38.28	94.40
3	MC3		10	2850	47	133.95	82.65
4	MC4		10	9270	8	74.16	45.76
5	MC5		20	220	18	3.96	2.44
Total Weight (KG)							306.84

BAR BENDING SCHEDULE OF END CROSS GIRDER (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	EC1		20	9570	6	57.42	141.60
2	EC2		20	9570	6	57.42	141.60
3	EC3		10	2850	47	133.95	82.65
4	EC4		10	9270	8	74.16	45.76
5	EC5		20	220	18	3.96	9.77
6	EC6		10	1000	3	4.80	2.96
Total Weight (KG)							424.33

BAR BENDING SCHEDULE OF PARAPET POST BASE (1 SIDE)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	MS1		10	1470	176	246.90	154.19
2	MS2		10	25420	6	152.52	94.10
BAR BENDING SCHEDULE OF RAILING POST (1 SIDE = 14Nos)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
3	MS3		16	2195	58	122.92	195.07
4	MS4		8	950	98	54.88	21.68
Total Weight (KG)							466.04

BAR BENDING SCHEDULE OF ROAD KERB (1 SIDE)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	MS1		10	1650	170	280.50	173.07
3	MS2		10	25420	6	152.52	94.10
Total Weight (KG)							267.17

BAR BENDING SCHEDULE OF FOOTPATH PRE CAST SLAB (1NO)							
S.No.	Bar Mark	Shape of Bar (Not to scale) Dimensions are in mm	Dia. of Bar (mm)	Length of each Bar (mm)	No. of Bars	Total Length of Bars (m)	Weight (kg)
1	MS7		8	1150	9	10.35	4.09
2	MS8		8	860	11	9.46	3.74
3	MS9		10	1150	9	10.35	6.39
4	MS10		10	860	11	9.46	5.84
Total Weight (KG)							20.05

GOVERNMENT OF NEPAL MINISTRY OF PHYSICAL INFRASTRUCTURE AND TRANSPORT DEPARTMENT OF ROADS BRIDGE DIVISION			
STANDARD SUPERSTRUCTURE DRAWING FOR ROAD BRIDGES			
Road Configuration: Width: 7.00m with 2 Footpaths each 1.50m wide		Overall Deck Width: 11.00 m	
Effective Simply Supported Span (parallel to center of Bearings): 25.0 m Reinforced Concrete Deck (per 30 Nos)		LIVE LOAD: IRC Class A, with 700 or 1 or 2 Lanes of Class A, with other girders, and Footpath Loading	
Dwg. No.: 177 of 4-Webbed RC-Slab-Deck 25.0 m-Span			
BAR BENDING SCHEDULE			
Reviewed by: Arun Kumar Vajrappa (Engineer, DoR)	Forwarded by: Jyotsna Mehta (SDE, DoR)	Date: June, 2021	
Recommended by: Dinesh Shrestha (CGO, DoR)	Approved by: Arjun Jung Thapa (CGO, DoR)	Revisions: 1. अर्जुन कुमार थापा महानिरीक्षक	